

INVERX

User Manual

Rechargeable Li-ion Battery System



HVB series

Beyond technology limited

All Rights Reserved

- **All Rights Reserved**

No part of this document can be reproduced in any form or by any means without the prior written permission of Beyond technology limited(hereinafter "BEYOND").

- **Trademarks**

INVERX and other BEYOND trademarks used in this manual are owned by BEYOND.

All other trademarks or registered trademarks mentioned in this manual are owned by their respective owners.

- **Software Licenses**

- It is prohibited to use data contained in firmware or software developed by BEYOND, in part or in full, for commercial purposes by any means.

- It is prohibited to perform reverse engineering, cracking, or any other operations that compromise the original program design of the software developed by BEYOND.

Beyond technology limited

Address: Room 213, Building 1,
No.16 Caipin Road,
Huangpu District,
Guangzhou 510700
P. R. China

E-mail: support@beyondlimit.com.cn

Tel: +86-20-37674339

About This Manual

The manual primarily encompasses product information, along with installation, operation, and maintenance guidelines.

It will refer to the device as the "inverter" unless otherwise specified.

- **Target Audience**

This manual is intended for professional technicians who have responsibilities for the installation, operation, and maintenance of inverters, as well as users who need to check inverter parameters.

Installation Requirements:

The installation of the inverter should only be carried out by professional technicians who meet the following requirements

- Possess knowledge of electronics, electrical wiring, and mechanical expertise, and be familiar with electrical and mechanical schematics.
- Have received professional training related to the installation and commissioning of electrical equipment.
- Capable of promptly responding to hazards or emergencies that may arise during the installation and commissioning process.
- Familiar with local standards and relevant safety regulations pertaining to electrical systems.
- Thoroughly read this manual and understand the safety instructions associated with the operations.

- **How to Use This Manual**

- Please carefully read this manual before utilizing the product and store it in a readily accessible location.
 - All content, images, trademarks, and symbols in this manual are the property of BEYOND. No part of this document may be reproduced by individuals not employed by BEYOND without written authorization.
- The contents of this manual may be periodically updated or revised, and the specifications of the actual product purchased should take precedence.

- **Symbols**

This manual incorporates crucial safety instructions that are emphasized using specific symbols. These symbols are employed to ensure the safety of individuals and property during product usage or to assist in maximizing product performance efficiently..

It is essential to thoroughly comprehend the significance of the warning symbols to enhance your utilization of the manual.

DANGER

Indicates the presence of high-risk potential hazards that, if not avoided, could result in severe injury or even death.

WARNING

Indicates the presence of moderate-risk potential hazards that, if not avoided, could result in serious injury or even death.

CAUTION

Indicates the presence of low-risk potential hazards that, if not avoided, may lead to minor or moderate injury.

NOTICE

Indicates potential risks that, if not avoided, may result in device malfunctions or financial losses.

The "NOTE" designation is used to indicate supplementary information, emphasized content, or helpful tips that can assist you, such as problem-solving techniques or time-saving suggestions.

Change History

Changes between document issues are cumulative, meaning that each subsequent document issue includes all the changes made in earlier issues.

Issue 1 (2023-12-06)

This issue is the first official release.

Contents

1 Safety Precaution	1
1.1 General Safety	1
1.2 Battery Safety	1
1.3 Emergency Measures	3
1.3.1 Battery Electrolyte Leakage	3
1.3.2 Fire	4
1.4 EU Declaration of Conformity	4
2 Product Introduction	5
2.1 Product Overview	5
2.2 Application Scenarios	5
2.3 Appearance	5
2.4 Dimensions	8
3 Check and Storage	9
3.1 Check Before Receiving	9
3.2 Scope of Delivery	9
3.3 Storage	10
4 System Installation	11
4.1 Installation Requirements	11
4.2 Installing the Battery System	12
4.2.1 Moving the Equipment	12
4.2.2 Installing the Battery System	12
5 Electrical Connection	15
5.1 Safety Precaution	15
5.2 Internal Electrical Connections of the Battery	16
5.2.1 Installing an Internal Ground Cable	16
5.2.2 Installing Communication Terminals	16
5.2.3 Installing Internal DC Terminals & Protection Cover	16
5.3 External Electrical Connections of the Battery	17
5.3.1 Connection the PE cable	17
5.3.2 Connecting the Power Cable	18
5.3.3 Connecting the Communication Cable	19
6 System Operation	21
6.1 Check Before Power ON	21
6.2 Power ON the Battery System	21
6.3 Indicator Status	22
6.3.1 Normal Status	22
6.3.2 Alarming Status	22
6.3.3 Fault Status	24
7 Maintenance	25
7.1 Power OFF the Battery System	25
7.2 Routine Maintenance	25
8 Appendix	26
8.1 Technical Data	26

1 Safety Precaution

Please ensure to strictly adhere to the safety instructions provided in the user manual during the operation of the system. These instructions are designed to ensure the safe and proper functioning of the equipment and to prevent any potential hazards or accidents.

NOTICE

The products have been designed and tested to comply with applicable safety regulations. It is essential to read and follow all safety instructions and cautions before performing any operations. Failure to do so may result in personal injury or property damage, as these products are electrical equipment.

1.1 General Safety

NOTICE

- The information in this user manual is subject to change due to product updates or other reasons. This guide is not a substitute for the product labels or the safety precautions in the user manual unless specified otherwise. All descriptions are for guidance purposes only.
- Before proceeding with any installations, carefully read and familiarize yourself with the user manual to understand the product and its associated precautions.
- All operations should be carried out by trained and knowledgeable technicians who are well-versed in local safety regulations and standards.
- When operating the equipment, utilize insulating tools and wear appropriate personal protective equipment (PPE) to ensure personal safety. This may include anti-static gloves, clothing, and wrist straps when handling electronic devices to protect both yourself and the equipment from damage.

1.2 Battery Safety

DANGER

- Power off the equipment before performing any operations to avoid danger. Strictly follow the safety precautions outlined in this manual and the safety labels on the equipment during operation. The battery system maintains a high voltage during operation.
- The inverter used with the battery must be approved by the battery manufacturer. You can obtain the approved list of batteries and matched inverters from BEYOND.
- Do not disassemble, modify, or replace any part of the battery or power control unit without official authorization from the manufacturer. Unauthorized actions may cause electrical shock or equipment damage, for which the manufacturer will not be held responsible.
- Avoid hitting, pulling, dragging, squeezing, or stepping on the equipment, and do not expose the battery to fire. Mishandling the battery may lead to explosions.
- Keep the battery away from high temperature environments. Ensure there is no direct sunlight or heat source near the battery. Temperatures exceeding 60°C can cause fires.
- Do not use a defective, broken, or damaged battery or power control unit. Damaged batteries may leak electrolyte.
- During transportation, take precautions to protect the battery pack and its components. Ensure that transportation personnel are trained and record all transportation operations. Keep the equipment







balanced to prevent falls.








- The battery equipment is heavy. Assign personnel according to its weight capacity to avoid exceeding the carrying capacity of the human body and causing injuries.
- If the battery fails to start, contact after-sales service immediately to prevent permanent damage to the battery.
- Do not move the battery system if it is connected to external battery modules. Contact after-sales service for any battery replacement or addition needs.

CAUTION

- Ensure the battery system is safeguarded during the transportation and storage phases.
- Trained professionals should handle transportation and maintain a record of all operations.
- Keep the equipment stable to prevent damage and minimize the risk of personal injuries.
- Maintain a minimum distance of 30mm between cables and heating components or heat sources to prevent damage to the cable insulation.
- Tie cables of the same type together for organization and avoid entanglement or crossing of cables.
- Keep cables of different types at least 30mm apart to prevent interference.
- Follow proper cable management practices to ensure safety.

Label Description

Symbol	Explanation
	Do not disassemble the Battery pack.
	Do not immerse the battery pack in water.
	Do not short-circuit the battery.
	Do not leave the battery near by fire.
	Read Technical Manual before servicing.
	Flammable Fire Hazard warning symbol.

	<p>Danger electrical hazard high voltage.</p>
	<p>CE mark of conformity.</p>
	<p>Regulatory compliance mark.</p>
	<p>UKCA mark of conformity.</p>
	<p>Read the user manual before maintenance.</p>
	<p>Recycling symbol.</p>
	<p>No waste.</p>

1.3 Emergency Measures

1.3.1 Battery Electrolyte Leakage

In case of electrolyte leakage from the battery module, it is crucial to avoid any contact with the leaked liquid or gas due to its corrosive nature. The electrolyte can cause skin irritation or chemical burns to individuals. If anyone accidentally comes into contact with the leaked substance, the following steps should be taken:

i: Inhalation of the leaked substance:

Immediately evacuate from the contaminated area. Seek immediate medical assistance.

ii: Eye contact with the leaked substance:

Rinse the affected eyes with clean water for at least 15 minutes. Seek immediate medical assistance.

iii: Skin contact with the leaked substance:

Thoroughly wash the affected area with soap and clean water. Seek immediate medical assistance.

iv: Ingestion of the leaked substance:

Induce vomiting, if possible. Seek immediate medical assistance.

It is crucial to prioritize safety and take prompt action by seeking appropriate medical attention in case of any contact with the leaked electrolyte.

1.3.2 Fire

When the ambient temperature exceeds 150°C, there is a risk of the battery exploding. In the event of a fire involving the battery, it is important to be aware that poisonous and hazardous gases may be released.

To effectively respond to a battery fire, please follow these guidelines:

- Ensure the availability of a carbon dioxide (CO₂) extinguisher, Novac1230, or FM-200 nearby. These types of fire extinguishers are suitable for tackling electrical fires, including battery fires.
- Avoid using water or ABC dry powder extinguishers to extinguish the fire. Water can spread the fire and dry powder may not be effective in suppressing a battery fire.
- If a fire occurs, contact the local fire department immediately. Firefighters should be equipped with full protective clothing and self-contained breathing apparatus to safely handle the situation.

It is crucial to prioritize safety and take appropriate measures to handle battery fires, including the use of suitable fire extinguishers and protective equipment for firefighting personnel.

1.4 EU Declaration of Conformity

Beyond technology limited hereby declares that the inverter without wireless communication modules sold in the European market meets the requirements of the following directives:

- Electromagnetic compatibility Directive 2014/30/EU (EMC)
- Electrical Apparatus Low Voltage Directive 2014/35/EU (LVD)
- Battery Directive 2006/66/EC and Amending Directive 2013/56/EU
- Waste Electrical and Electronic Equipment 2012/19/EU
- Registration, Evaluation, Authorization and Restriction of Chemicals (EC) No.RZUN2023-2770 (REACH)


2 Product Introduction

2.1 Product Overview


The battery system, comprising a power control unit (HVBC) and battery modules, is responsible for storing and discharging electrical energy based on the needs of the solar energy storage system. The energy storage system operates with high-voltage direct current (DC) input and output ports.

NOTICE

The battery system allows for capacity expansion, with a maximum of 8 battery modules that can be added to increase the usable energy of the system. It is important to strictly adhere to the expansion requirements specified by the manufacturer. For more information and detailed guidelines, please consult the Dealer or Manufacturer. Failure to follow the recommended expansion procedures may result in issues such as undervoltage, overvoltage, or voltage differences within the battery system.

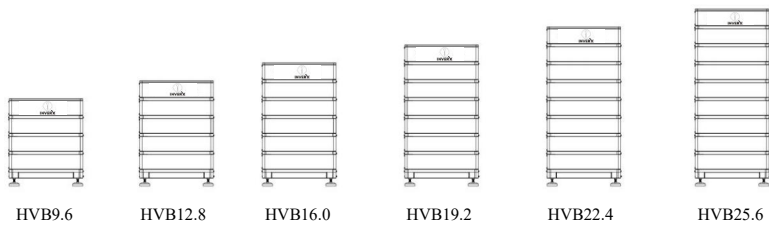


2.2 Application Scenarios

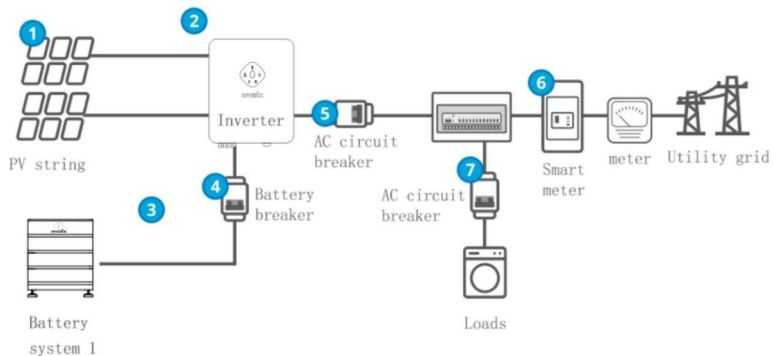

2.3 Appearance

Battery system appearance

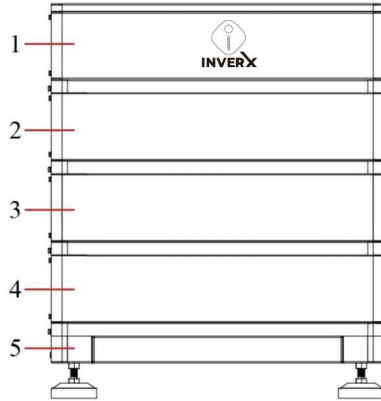


No.	Parts
1	HVBc
2, 3, 4	Battery modules
5	Base

NOTICE


- Make sure to install the power control unit (HVBc) above the battery modules. Avoid installing any battery modules above the HVBc.
- This manual provides instructions for the installation and electrical connection of 5 battery modules.

Battery appearance

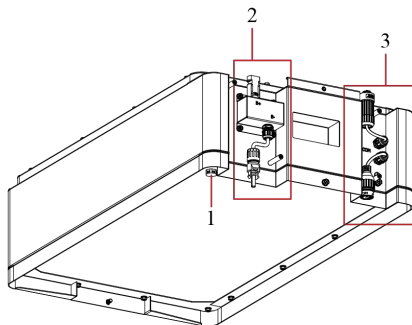



No.	Parts
1	Ventilation valve
2	Power Connector
3	Communication Connector

Base appearance


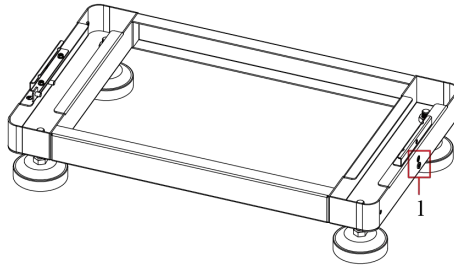


No.	Parts
1	Grounding point

Power control appearance



Right View	Front View
------------	------------

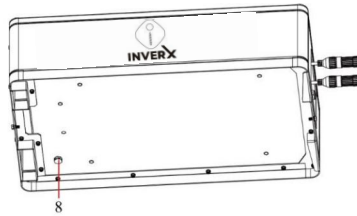


Left View	Bottom View
-----------	-------------

1 Communication terminal (COM)	2 Testing terminal	3 DC terminal (BAT)
4 Grounding point	5 Air switch	6 SOC indicator
7 Multifunction button indicator	8 Ventilation value	

2.4 Dimensions

HVB series

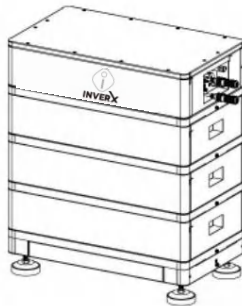

HVB	W	H	D
Battery module	615mm	165mm	360mm
Base	615mm	150mm	360mm
Power control unit	615mm	165mm	360mm

3 Check and Storage

3.1 Check Before Receiving

Check the following items prior to receiving the product:

1. Inspect the outer packaging box for any signs of damage, such as holes, cracks, deformation, or other indications of equipment damage. If any damage is detected, refrain from unpacking the package and promptly notify the supplier.
2. Verify that the product model matches your request. If the product model does not correspond to your specifications, refrain from unpacking the product and contact the supplier.
3. Confirm that the deliverables include the correct model and all the necessary components. Ensure that the contents are complete and nothing is missing.

3.2 Scope of Delivery


Checking the Outer Packing

Inspect the outer packing for any signs of damage, such as holes or cracks. Additionally, verify the battery model to ensure it corresponds to your request. If you notice any damage or if the battery model is incorrect, refrain from unpacking the product, and promptly contact your dealer for further assistance.

Checking Deliverables


Upon unpacking the battery, carefully inspect the deliverables to ensure they are undamaged, complete, and free from any noticeable defects. If you find any missing or damaged items, promptly contact your dealer for resolution. Please refer to the Packing List within the packing case for specific information regarding the number of deliverables that should have been included with the battery.

Power Control Unit

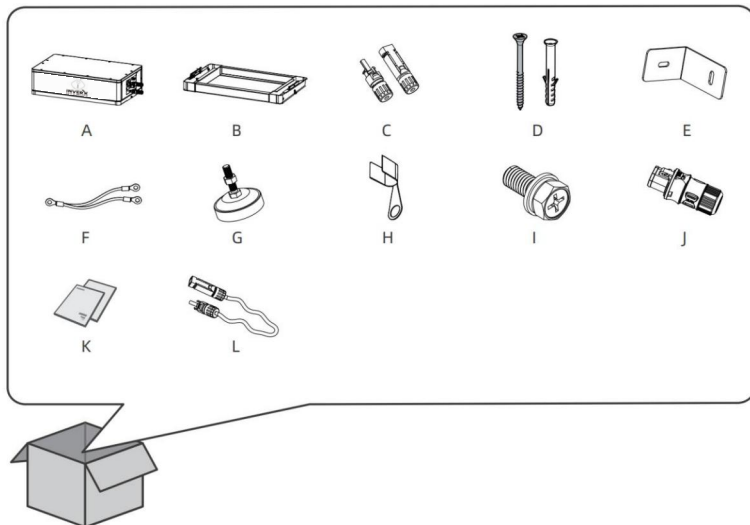

Item	Name	Quantity
A	HV Box	1
B	Base	1
C	MC4	1
D	Expansion screws	4
E	Installation bracket	4
F	Grounding cable (For bottom one)	1
G	Support legs	4
H	Grounding terminal	3
I	Grounding screws	3
J	Communication terminal	1
K	User manual	1
L	Power cable with MC4 connectors	1

Battery module

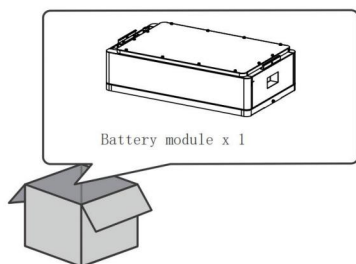

3.3 Storage

If the equipment is not intended for immediate installation or use, please ensure that the storage environment meets the following requirements:


- Do not unpack the outer packing box or discard the desiccant.
- If the equipment is not installed within three days of unpacking, repack and store it in the original packing box.
- Follow the labels and requirements on the packing box when stacking the equipment.
- Take caution when stacking the equipment to prevent it from falling.
- Keep the equipment away from flammable, explosive, and corrosive substances.
- Store the equipment in a cool place away from direct sunlight.
- Ensure the storage location is clean, with appropriate temperature and humidity levels to prevent condensation.
- Maintain a State of Charge (SOC) between 25% and 50% during storage. Perform charge-discharge cycles every six months.
- Recommended storage temperature: 0°C to 35°C (for periods less than one year), -20°C to 0°C or 35°C to 45°C (for periods less than one month).
- Recommended storage humidity: 0% to 95% RH (without condensation). Do not install the battery if moisture or condensation is present.

4 System Installation

4.1 Installation Requirements

Installation Environment Requirements:

- Do not install the equipment near flammable, explosive, or corrosive materials.
- Avoid installing the equipment in accessible areas, especially within reach of children. The equipment generates high temperatures during operation, so touching the surface should be avoided to prevent burns.
- Take care to avoid drilling holes near water pipes and buried cables in walls.
- Install the equipment in a sheltered location to protect it from direct sunlight, rain, and snow. If necessary, construct a sunshade.
- Ensure that the equipment is installed in a well-ventilated area to facilitate proper dissipation of heat. The installation space should be spacious enough for ease of operation.
- The equipment's ingress protection rating determines whether it can be installed indoors or outdoors. Additionally, ensure that the temperature and humidity at the installation site are within the specified range.
- Install the equipment at a suitable height for convenient operation, maintenance, electrical connections, and easy access to indicators and labels.
- The installation altitude should not exceed 2000m above sea level.
- Keep the equipment away from electromagnetic interference. If there are any radio or wireless communication devices operating below 30MHz near the equipment, ensure that the equipment is at least 30m away from those devices.

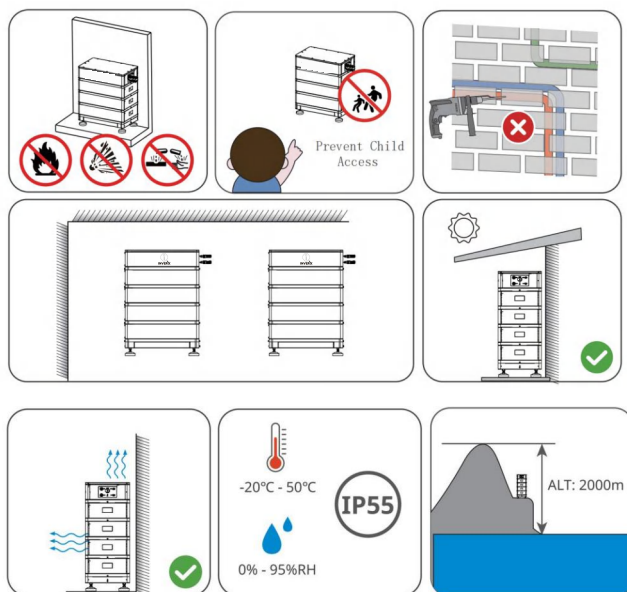


Mounting Support Requirements:

- Ensure that the mounting support is made of nonflammable and fireproof materials.
- The surface where the equipment is mounted should be sturdy enough to support the weight of the product.
- Position the battery system near a wall and securely install the locking brackets to prevent the battery from accidentally falling.

Installation Angle Requirements

- The equipment must be installed vertically, without any tilt or upside down.

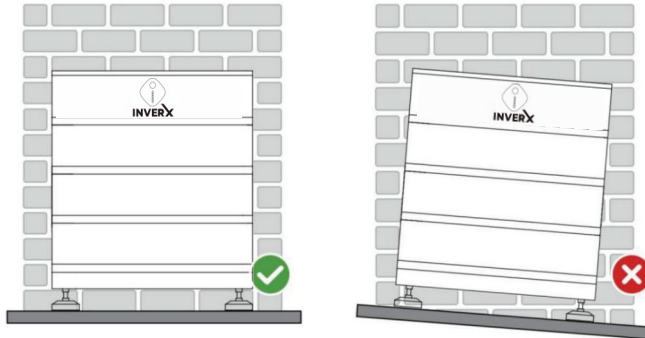

4.2 Installing the Battery System

4.2.1 Moving the Equipment



CAUTION

- All operations, including transportation, turnover, and installation, must comply with the laws and regulations of the country or region where the equipment is located.
- Before moving the equipment, carefully consider its weight and allocate an adequate number of personnel to ensure safe handling and to prevent personal injury.
- It is recommended to wear safety gloves during the moving process to minimize the risk of personal injury.
- Maintain balance and stability while moving the equipment to prevent it from falling or tipping over, which can result in both personal injury and equipment damage.

4.2.2 Installing the Battery System

NOTICE

- Make sure the base is positioned vertically on the floor.
- Ensure that the base is securely attached to the wall with the arrow pointing outward.
- Ensure that all batteries are securely attached to the wall with the arrow pointing outward.
- When placing the upper battery module, align the holes of the upper and lower battery modules.
- Ensure that the locking bracket is securely attached to the wall.
- Do not install both locking brackets on one side; they should be installed on opposite sides for proper stability.

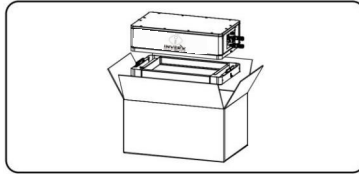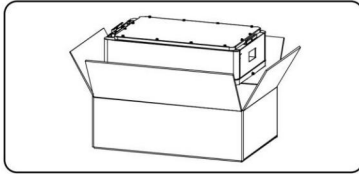

Step 1: Fix the adjustable feet securely onto the base, ensuring the base is level and stable without any tilting or shaking.

Step 2: Place the base on the wall where you intend to install it. Use a pencil or marker to mark the drilling positions on the wall. Then, remove the base from the wall.







Step 3: Carefully drill holes at the marked positions on the wall using an electric drill.


Step 4: Insert the expansion bolts into the drilled holes and tighten them firmly. Make sure the base is properly aligned and installed in the correct direction. Place the battery module on the installed base, ensuring it aligns with the base and is installed in the same direction.

Step 5: Install the remaining batteries based on the specific type and configuration of your battery system. Follow the manufacturer's instructions for proper installation.

Step 6: Stack the HVBc on top of the last battery module, aligning it in the same direction. Tighten the screws between the battery modules to secure them in place.


Step 7: Use a screwdriver to remove the terminal cover, preparing for Electrical Connection.

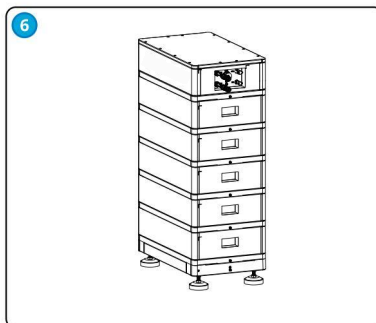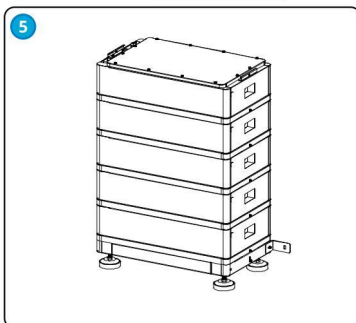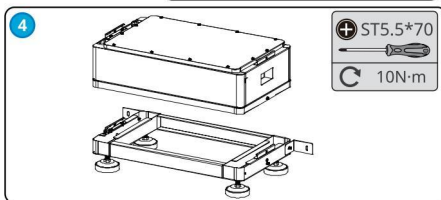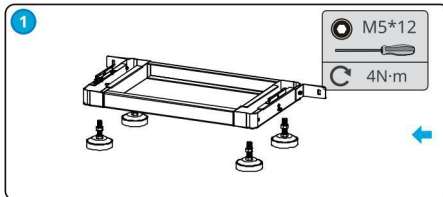

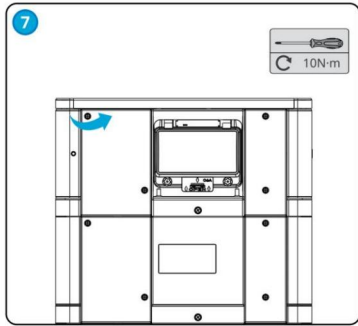

5 Electrical Connection

5.1 Safety Precaution

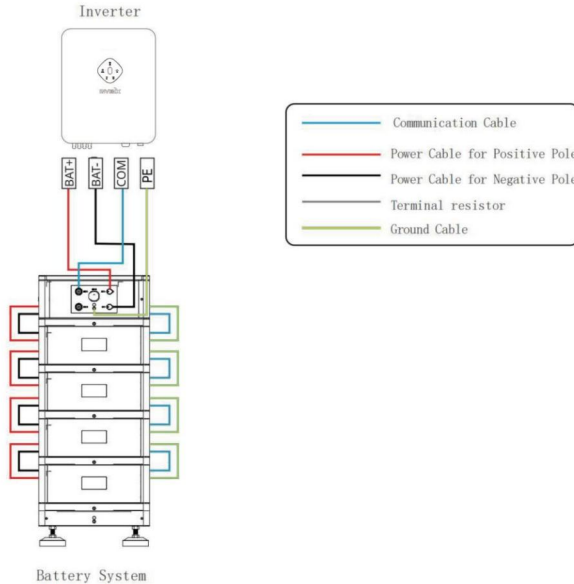

DANGER

- Prior to any operations, ensure that the power is turned off to prevent any potential dangers. It is crucial to strictly adhere to the safety precautions provided in this manual as well as the safety labels affixed to the equipment.
- When conducting electrical connections, it is essential to follow the specifications and guidelines mandated by the local laws and regulations.
- Properly organize and separate cables based on their types. Avoid entangling or crossing different cables.
- During the process of crimping terminals, ensure that the cable conductor makes full contact with the terminal while ensuring that the cable insulation is not crimped with the terminal. This ensures optimal functionality and reliability of the device, preventing any potential damage to the terminal block and other related issues.

NOTICE

- When conducting electrical connections, it is essential to wear appropriate personal protective equipment such as safety shoes, safety gloves, and insulating gloves. These protective measures ensure your safety during the process.
- It is recommended to have qualified professionals perform all electrical connections. Their expertise

and knowledge ensure proper installation and reduce the risk of errors or accidents.

- The cable colors mentioned in this document are for reference purposes only. It is crucial to ensure that the cable specifications meet the requirements set by local laws and regulations.


5.2 Internal Electrical Connections of the Battery

5.2.1 Installing an Internal Ground Cable

DANGER


Make sure to securely connect the PE cable to avoid the risk of electric shocks.

Step1: Make sure to connect the PE cable to both the battery power control modules and the battery expansion modules. This ensures proper grounding and safety during the operation of the battery system.

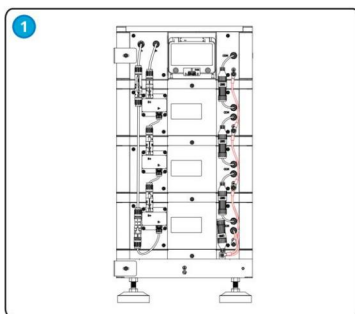

5.2.2 Installing Communication Terminals


Connecting Communication Cables between the Power Control Unit and Battery Extension Modules.

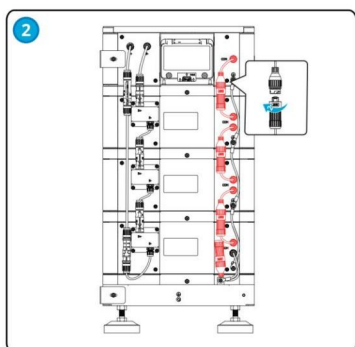

5.2.3 Installing Internal DC Terminals & Protection Cover

Step1: Insert the positive and negative connectors that came with the battery into the corresponding positive and negative battery cascading terminals (B+ and B-). Make sure the connectors are securely and properly inserted to ensure a reliable connection.

Step2: Tighten and secure the protective cover onto the battery and HVBe using screws, ensuring that they are aligned and installed in the correct direction.

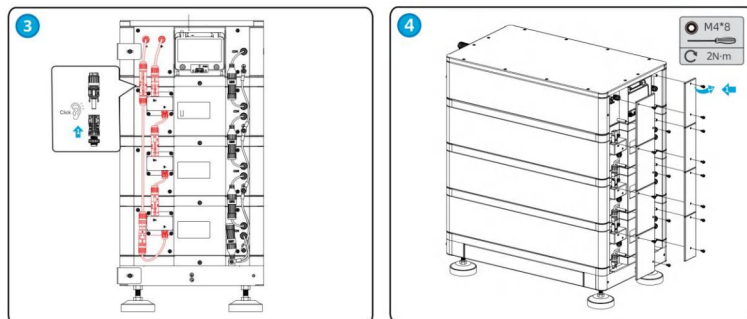

NOTICE


After the positive and negative connectors snap into place, pull the DC input power cables back to ensure that they are connected securely. This will help ensure a reliable and stable connection between the components.

5.3 External Electrical Connections of the Battery

5.3.1 Connection the PE cable

NOTICE

- Prior to installing the equipment, connect the PE cable first. It is essential for safety purposes. Similarly, disconnect the PE cable before dismantling the equipment.
- After crimping the cable, make sure that it has a drawing force of at least 400N. This will ensure a secure and reliable connection.
- The PE cable should be connected to either the HVBC or the base in the same manner. Follow the provided instructions for the specific equipment.
- It is the responsibility of the customer to prepare the PE cable. The recommended specifications for the cable are as follows:
 - Type: Single-core outdoor copper cable
 - Cross-sectional area: 4-6mm²

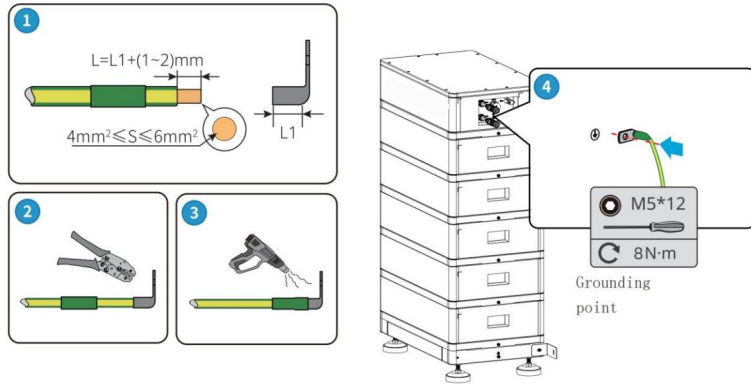

5.3.2 Connecting the Power Cable

NOTICE

- Ensure battery system is powered off before connecting power cable to prevent high voltage hazards.
- Customers should prepare DC input cable. Connect red power connector to red wire harness and black power connector to black wire harness. Use outdoor-compliant cable.
- Properly install back cover without leaving any gaps.
- Cover unused ports for protection.


DANGER

High voltage precautions:


- Prior to conducting any electrical operations, ensure that all cables are free of voltage.
- Do not connect the DC switch and AC circuit breaker until the electrical connections are completed.

To maintain IP65 protection, only use the provided connector.


Step 1: Strip the insulation from each DC cable by approximately 7 mm to 8 mm.




Step 2: Assembling the Crimp contact and cable, use the crimping pliers to securely assemble the cable ends.

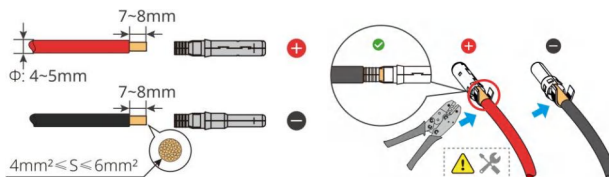


Step 3: Lead the cable through the cable gland and insert the crimp contact into the insulator until it audibly snaps into place. Pull the cable gently backward to ensure a firm connection. Tighten the cable gland and insulator using a torque of 2.5 N.m to 3 N.m.

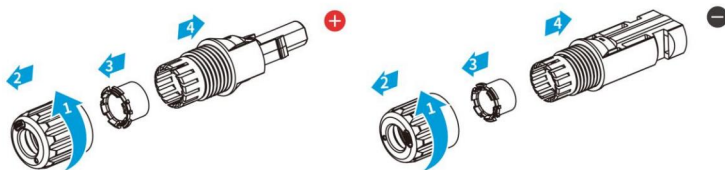

Step 4: Verify the polarity correctness.

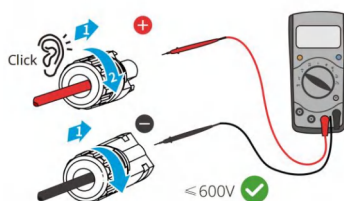

Step 5: Connect the positive terminal of the cable to the positive terminal of the battery, and connect the negative terminal of the cable to the negative terminal of the battery. When you hear a “Click”, it indicates that the connection is complete.

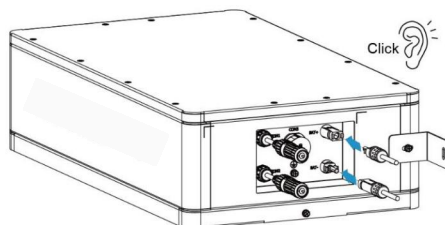

5.3.3 Connecting the Communication Cable


Step 1: Remove the waterproof protective cover from the HVBC.

Step 2: Disassemble the waterproof protective cover to prepare for wiring.






Step 3: Thread the communication cables through the waterproof protective cover in sequence.

Step 4: Connect the communication cables that pass through the protective cover to the communication ports on the HVBC and tighten them.

Step 5: Verify that the protective cover is installed correctly and securely.



PIN	Description
5	CAN_H
6	CAN_L
1, 2, 3, 4, 7, 8	N/A

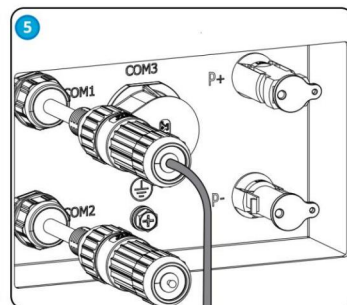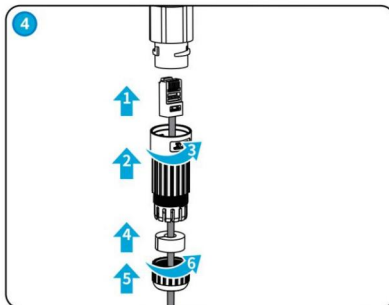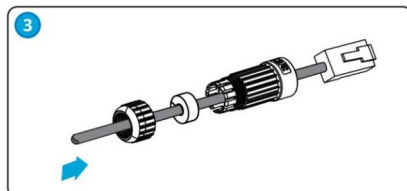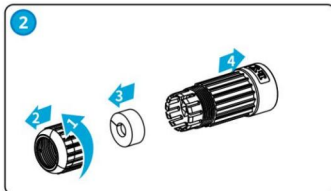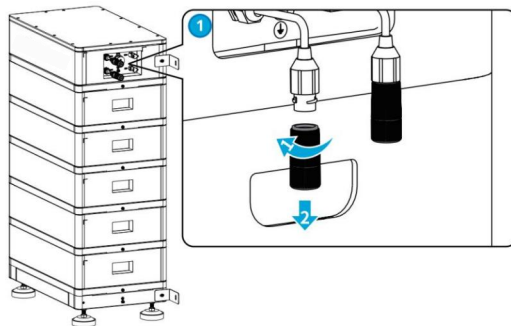

6 System Operation

6.1 Check Before Power ON

Check the following items before powering on to ensure the safety and proper functioning of the battery system:

- Verify that the inverter is securely installed in a clean and well-ventilated location.
- Ensure that the PE cable, power cable, communication cable, and terminal resistor are connected correctly and securely.
- Inspect the cable ties to ensure they are intact, properly routed, and evenly secured.
- Seal any unused ports and terminals to prevent dust or debris from entering.

6.2 Power ON the Battery System


NOTICE

- The installation of the DC breaker between the inverter and the battery must comply with the relevant local laws and regulations.
- The DC breaker should be capable of simultaneously isolating both the positive and negative conductors.

Step 1: (Optional) Activate the breaker between the inverter and the battery system.

Step 2: Activate the air switch of the battery system.

Step 3: Power on the inverter in the system by following the instructions provided in the inverter's user manual.

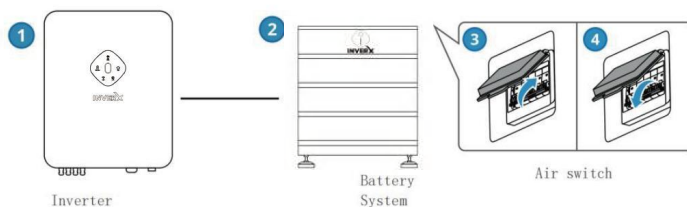

6.3 Indicator Status



Button Indicator	Status
Green	Standby or Working
Red	Alarming or Faulty

6.3.1 Normal Status











Button Indicator	SOC Indicator	Description
Green for 2s, Off for 5s, Cycling continuously		SOC < 5%
		5% ≤ SOC < 25%
		25% ≤ SOC < 50%
		50% ≤ SOC < 75%
		75% ≤ SOC < 95%
		SOC ≥ 95%



NOTICEa

- The State of Charge (SOC) indicator remains continuously illuminated during the charging process.
- The SOC indicator flashes once intermittently during the discharging process.










6.3.2 Alarming Status

Button indicator	SOC Indicator	Alarm	Solutions
		Low State of Charge (SOC)	Please get in touch with our after-sales service.
		High Charging Current	Power off the system and wait for a duration of 2 hours. If the issue continues to persist after this period, kindly reach out to our after-sales service for further assistance and support.

Steady red		High Discharging Current	Power off the system and wait for a duration of 2 hours. If the issue continues to persist after this period, kindly reach out to our after-sales service for further assistance and support.
		High Terminal Temperature	Power off the system and wait for a duration of 2 hours. If the issue continues to persist after this period, kindly reach out to our after-sales service for further assistance and support.
		High Battery Temperature	Power off the system and wait for a duration of 2 hours. If the issue continues to persist after this period, kindly reach out to our after-sales service for further assistance and support.
		Low Temperature in Charging Battery	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		High Temperature in Charging Battery	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		Low Temperature in Discharging Battery	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		High Temperature in Discharging Battery	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
Steady red		High Single Cell Voltage	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		Low Single Cell Voltage	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		Large Voltage Difference in the Battery	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.

	High Total Voltage	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
	Low Total Voltage	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.

6.3.3 Fault Status

Button indicator	SOC Indicator	Fault	Solutions
Steady red		Insulation Fault	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		Sticking of Contactor	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		EEPROM Fault	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		Current Sensor Fault	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		Internal Communication Fault	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		Balancing Fault	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
Steady red		No Serial Number Error	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		Temperature Sensor Fault	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.
		Other Faults	Reboot the battery system. If the issue continues to persist, please get in touch with our customer support team for further assistance.

7 Maintenance

7.1 Power OFF the Battery System

DANGER

- Ensure that the battery system is powered off before performing any operations or maintenance tasks. Failure to do so may result in equipment damage or electric shocks.
- To restart the battery, simply push the air switch.

To power off the battery system and prevent any potential damage, please follow one of the two methods below:

Method one:

Step 1: Refer to the user manual of the inverter and follow the instructions to turn off the inverter in the system.

Step 2: Disconnect the air switch and ensure that the SOC indicator and multifunction button indicator of the HVBC are switched off.

Method two:

Step 1: Refer to the user manual of the inverter and follow the instructions to turn off the inverter in the system.

Step 2: Long press the multifunction button indicator for more than 15 seconds, and confirm that the SOC indicator and multifunction button indicator of the HVBC are switched off.

7.2 Routine Maintenance

WARNING

- If you encounter any issues that could potentially affect the battery or hybrid inverter, please contact the after-sales service for assistance. Unauthorized disassembly is strictly prohibited.
- If you notice exposed copper conductors, please contact the after-sales service for assistance. Do not touch or attempt to disassemble the equipment privately due to the risk of high voltage.
- In the event of any other emergencies, please contact the after-sales service immediately. Follow the provided instructions or wait for the after-sales service personnel to assist you.

Maintaining Item	Maintaining Period
Check the securing of the locking brackets. If they are not properly secured, tighten them as necessary.	Once every 6 months
Inspect the outer enclosure for any signs of damage or breakage. If any issues are found, repair the painting or contact the after-sales service for assistance.	Once every 6 months
Check for any exposed cables. If any cables are exposed, replace them or contact the after-sales service for help.	Once every 6 months
Inspect the battery module for any dust accumulation. Clean the dust if present to prevent it from affecting heat dissipation.	Once every 6 months
Check for the presence of any liquid or pests near the battery. Take measures to prevent long-term intrusion.	Once every 6 months

8 Appendix

8.1 Technical Data

Battery System (high voltage)	HVB9.6	HVB12.8	HVB16.0
Nominal Energy (kWh)	9.60	12.80	16.00
Usable Energy (kWh)*1	8.64	11.52	14.40
Module Parameter	64V 50Ah 615*360*175mm 35kg		
Cell Type	LFP (LiFePO4)		
Max.Module Configuration	3	4	5
Nominal voltage (V)	192	256	320
Operating voltage range (V)	171~216	228~288	285~360
Max.continuous current (A)*2	30		
Max.continuous power (kW)*2	5.76	7.68	9.60
Communication	CAN/RS485		
Weight (kg)	120	155	190
Dimensions (W*D*H)(mm)	615*360*730	615*360*880	615*360*1030
Operating Temperature (°C)	Charge: 0~50/Discharge: -20~50		
Storage Temperature (°C)	-20~45 (≤1 months)/-20~25 (≤6 months)		
Humidity	0~95%		
Altitude (m)	≤2000		
Enclosure type	IP65 (indoor/outdoor)		
Cooling	Natural convection		
Installation location	Floor-standing		
Display	SOC indicator, status indicator		

Battery System (high voltage)	HVB19.2	HVB22.4	HVB25.6
Nominal Energy (kWh)	19.20	22.40	25.60
Usable Energy (kWh) *1	17.28	20.16	23.04
Module Parameter	64V 50Ah 615*360*175mm 35kg		
Cell Type	LFP (LiFePO4)		
Max.Module Configuration	6	7	8
Nominal voltage (V)	384	448	512
Operating voltage range (V)	342~432	399~504	456~576
Max.continuous current (A) *2	30		
Max.continuous power (kW) *2	11.52	13.44	15.36
Communication	CAN/RS485		
Weight (kg)	225	260	295
Dimensions (W*D*H)(mm)	615*360*1180	615*360*1330	615*360*1480
Operating Temperature (°C)	Charge: 0~50/Discharge: -20~50		
Storage Temperature (°C)	-20~45 (≤1 months)/-20~25 (≤6 months)		
Humidity	0~95%		
Altitude (m)	≤2000		
Enclosure type	IP65 (indoor/outdoor)		
Cooling	Natural convection		
Installation location	Floor-standing		
Display	SOC indicator, status indicator		

1. Test conditions: 3.0~3.5V, 0.2C charger (CC-CV) and Discharger at 25±3°C;
2. Max.continuous current/power derating will occur related to temperature/SOC/Humidity;